THREADED BUTTERFLY VALVE GEAR OPERATED WITH TAMPER SWITCH

Model GLR-300-T
Threaded 300 psi
Sizes: 1”, 1 ¼”, 1 ½” & 2”

LISTED
EX15826



PRODUCT DESCRIPTION

AG butterfly valves have a hand wheel operator, , which close slowly in order to prevent water hammer and shock in the fire protection on service. These butterfly valves have been designed to be installed in any orientation and monitored to signal if the valve is opened or closed.


The AG grooved butterfly valve should be connected to the piping system with approved couplings or flange adapters. Flow may be from either direction, and the valve may be positioned in any direction.

TECHNICAL DATA

Model	GLR-300-T Butterfly valve FM/UL Threaded 300 psi Gear operated with tamper switch
Sizes	1” DN25 1 ¼” DN32 1 ½” DN40 2” DN50
End connection	Threaded ANSI B 1-20.1 NPT
Operated	Gear Position indicator Tamper Switch
Maximum working pressure	21,4 bar (300 psi)
Maximum test pressure	42,8 bar (600 psi)
Maximum working temperature	250º F (120ºC)
Switch rating	10,1 A / 115 VAC – 60 Hz 0,5 A / 28 VDC
Uses	Outdoors and indoors

C/Alfoz de Bricia nº4 | P.I. Villalonquéjar | 09001 Burgos (Spain) | Tlfno: +34 947 28 11 08

DIMENSIONS (mm)

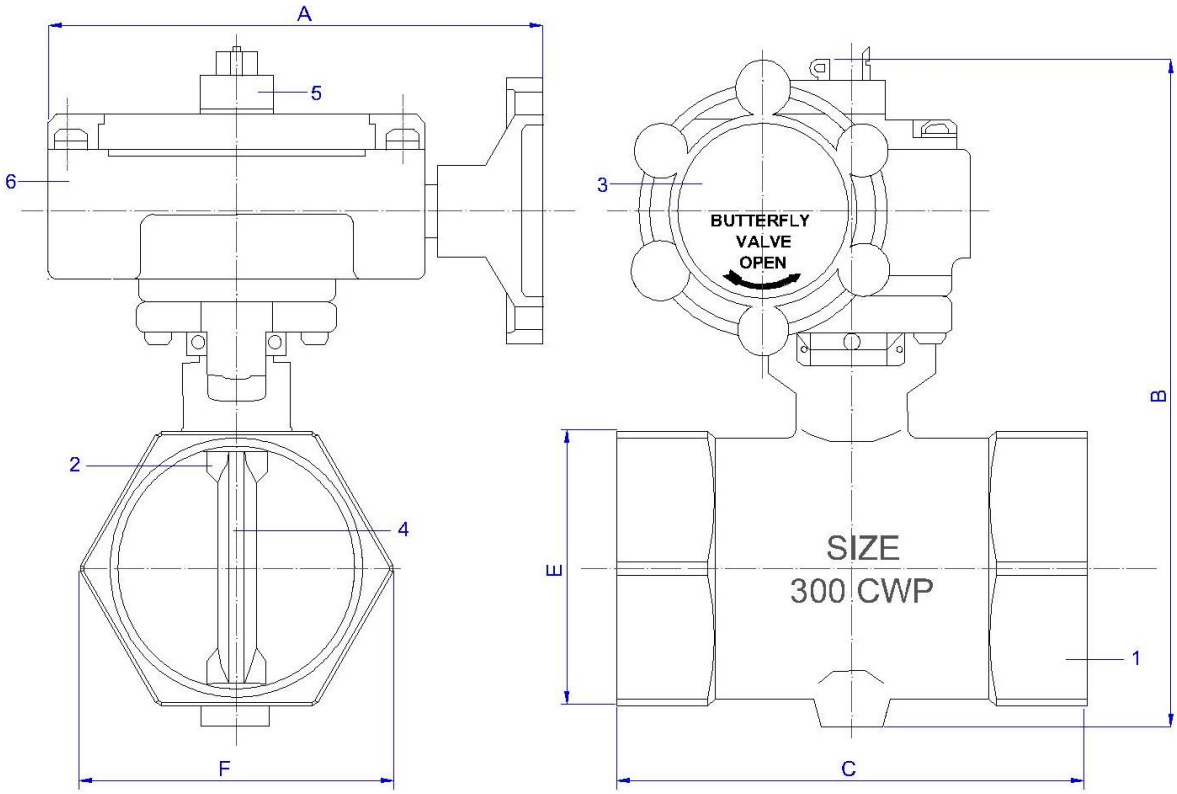

SIZES		DIMENSIONS (mm)					EN12116 ISO5211
Inch	mm	A±3	B±3	C±1	E	F	
1	25	118	125,4	54,0	39,7	44,5	F04/F05
1 ¼	32	118	130,2	66,7	49,2	55,0	F04/F05
1 ½	40	118	142,1	73,0	55,6	60,3	F04/F05
2”	50	118	155,6	82,6	70,0	79,0	F04/F05

MATERIAL LIST

ITEM	NAME	MATERIAL	QUANTITY
1	Body	Bronze	1
2	Disc	Stainless Steel	2
3	Handwheel	WCB	1
4	Seat	Viton	1
5	Indicator	Powder metal	1
6	Housing	Brass	1

C/Alfoz de Bricia nº4 | P.I. Villalonquéjar | 09001 Burgos (Spain) | Tlfno: +34 947 28 11 08

INSTALLATION

When the valves are received from the manufacturer they should be handled carefully to avoid breakage and damage to the seating area. Before installation of the valve, clean piping, flange and coupling. When the valve closes hard, it is usually due to debris lodged in the sealing area. Often this may be corrected by backing off the hand wheel and closing again.

The valve should never be forced to seat by applying a wrench to the hand wheel as this may distort the valve components or score the sealing surface. The use of excessive force to open or close the valve violates all warranties whether express or implied.

The inlet and outlet pipe adjacent to the valve should be properly supported to prevent excessive stress on the valve body. The valves should not be used to force a pipeline into position as this may result in distortion of the valve body.

Conduit and electrical connections to the optional tamper switch must be in accordance with National Electrical Code (NFPA 72) and requirements of the local authority having jurisdiction.


All replacement parts must be obtained from the manufacturer to assure proper operation of the valve, and to maintain approval of the device.

1. The valve can be installed in any orientation in a piping system with standard ASME B1.20.1 NPT (PT available upon request) or standard roll or cut grooved pipe.
2. When threading to pipe, apply adequate pipe sealants, use a wrench to cramp on the hexagon end of the valve.
3. The tamper switch-1 has dual leads on the terminals. This switch is used for connection of the supervisory circuit of a listed fire alarm control panel. Switch 2 has a single lead and used for connection of auxiliary equipment. All the unused wires need to be capped with lead nuts and tucked into a junction box. All connections need to be reviewed and approved by the jurisdictional authorities.
4. A nº 14 green wire is fixed in inner of the switch housing. It is provided as a ground for the housing.
5. Installation must comply with NFPA 13 and NFPA 72.
6. The valves are intended for use with ANSI B36.10 Schedule 40 and/or Schedule 80 pipes.

SWITCH INSTALATION


AG butterfly valves are provided with internal supervisory position switches. The tamper switch operates by a cam connected to the valves stem. The switch will change position within two (2) full turns of the hand wheel fro, the fully open position.

SWITCH #1: DUAL LEADS SOLDERED TO SWITCH TABS

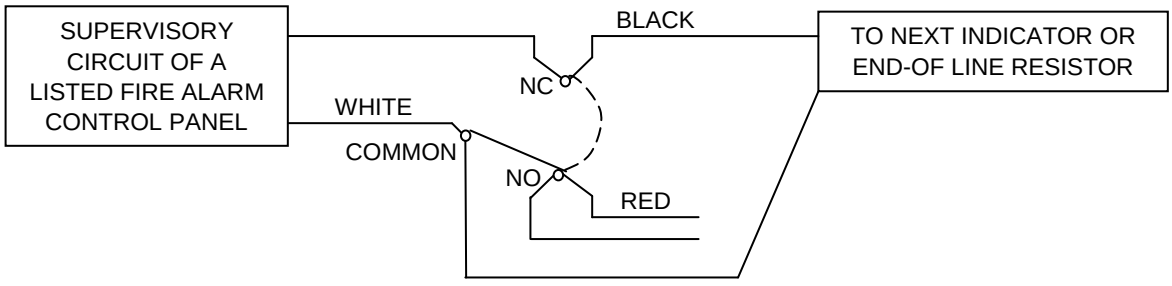

C/Alfoz de Bricia nº4 | P.I. Villalonquéjar | 09001 Burgos (Spain) | Tlfno: +34 947 28 11 08

SWITCH #2: SINGLE LEADS SOLDERED TO SWITCH TABS

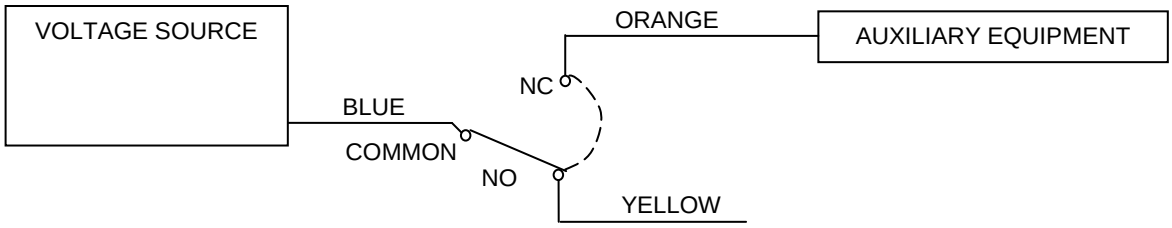

Green wire is provided as ground for the switch housing.

Switch rating: 10.1 Amps-125/250VAC-60Hz.

Actual switch application rating: 10 Amps/115 VAC-60Hz, 0,5 Amps/28 VDC.

ORDERING INFORMATION

SIZE	CODE
1 ¼" DN32	VM025RO300V0
1 ½" DN40	VM032RO300V0
2" DN50	VM040RO300V0
2 ½" DN65	VM050RO300V0

Specify:

Model	
Quantity	
Size of valve	

The equipment presented in this data sheet is to be installed in accordance with the latest published Standards of the national fire protection association (NFPA), FM Global, LPCB, VdS or other similar organizations, also with the provisions of governmental codes or ordinances whenever applicable.
This documentation is not contractual. AG Fire Sprinkler reserves the right to any kind of change without notice.

C/Alfoz de Bricia nº4 | P.I. Villalonquéjar | 09001 Burgos (Spain) | Tlfno: +34 947 28 11 08