VERTICAL INDICATOR POST

Model PIV

For 4”, 6”, 8”, 10” and 12” valves

c UL us LISTED EX15964

FM APPROVED



PRODUCT DESCRIPTION


The AG Fire Sprinkler vertical indicator post Model VIP indicate if the valve is opened (OPEN) or closed (SHUT). This vertical post enables underground fire line valve to be operating at ground level with operating wrench.

TECHNICAL DATA

Model	PIV
Statement	Vertical indicator post provides a means to operate a buried or otherwise inaccessible valve and able to indicate the open or shut position of the valve
Adjustment	The opened “OPEN” and closed “SHUT” positions can be adjusted
Coating	Fusion Bonded Epoxy coating in accordance with ANSI/AWWA C550
Uses	Underground fire line valve
Finish	Red RAL 3000

C/Alfoz de Bricia nº4 | P.I. Villalonquéjar | 09001 Burgos (Spain) | Tlfno: +34 947 28 11 08

MATERIALS

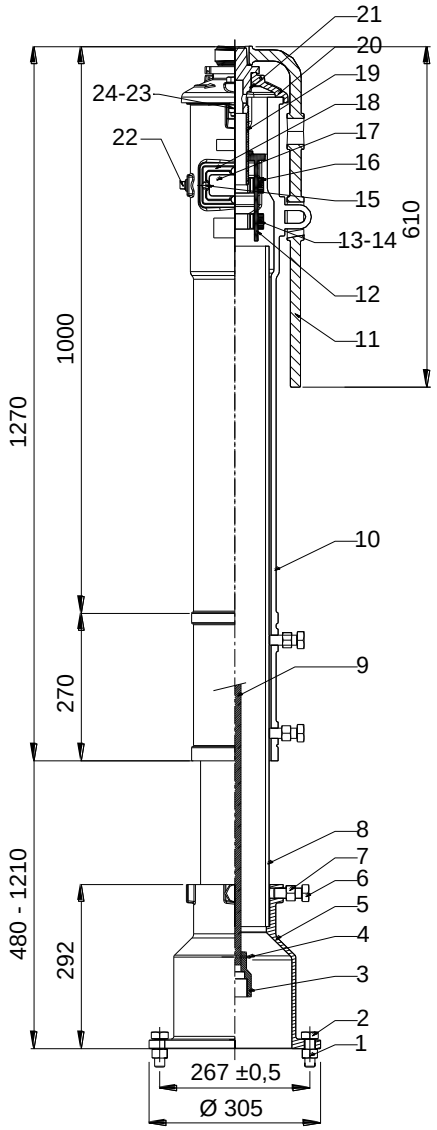

ITEM	DESCRIPTION	MATERIAL
1	Hex Nut	Carbon Steel Zinc Plated
2	Hex Bolt	Carbon Steel Zinc Plated
3	Socket	EN-GJS-450-10
4	Cotter Pin	SS304
5	Base Flange	Cast Iron EN-GLJ-200
6	Hex Bolt	Carbon Steel Zinc Plated
7	Hex Nut	Carbon Steel Zinc Plated
8	Standpipe	Carbon Steel
9	Stem 1” Square	Carbon Steel
10	Body	Cast Iron EN-GLJ-200
11	Locking Wrench	EN-GJS-450-10
12	Target Carrier Nut	Cast Aluminum
13	Hex Bolt	Carbon Steel Zinc Plated
14	Hex Nut	Carbon Steel Zinc Plated
15	Hex Bolt	Carbon Steel Zinc Plated
16	Target	Cast Aluminum
17	Window Glass	Plexiglass
18	Gasket	EPDM
19	Operating Nut	SS304
20	Top Section	Cast Iron EN-GLJ-200
21	Snap Ring	Spring Steel
22	Plug	Malleable Iron
23	Square Nut	Carbon Steel Zinc Plated
24	Hex bolt	Carbon Steel Zinc Plated

FIELD ADJUSTMENT

1. Remove the top section from the top of the Indicator Post assembly.
2. Cut the required stem length and adjust the Standpipe to match up to the ground line.
3. Set the “OPEN” and “SHUT” targets for the appropriate valve size.
4. Reattach the Top Section to the top of the Indicator Post assembly.

ORDERING INFORMATION

MODEL	CODE
Vertical indicator post	VPIVFMUL

Specify:

Model	
Quantity	

The equipment presented in this bulletin is to be installed in accordance with the latest published Standard of the National Fire Protection Association, Factory Mutual Research Corporation, or other similar organizations and also with the provisions of governmental codes or ordinances whenever applicable.
This documentation is not contractual. AG Fire Sprinkler reserves the right to any kind of change without notice.

C/Alfoz de Bricia nº4 | P.I. Villalonquéjar | 09001 Burgos (Spain) | Tlfno: +34 947 28 11 08