WALL INDICATOR POST (HORIZONTAL)

Model PIP

For 4”, 6”, 8”, 10” and 12” valves

c UL us LISTED EX15964

FM APPROVED



PRODUCT DESCRIPTION

The AG Fire Sprinkler wall indicator post Model PIP indicate if the valve is opened (OPEN) or closed (SHUT). This wall post enables installation of fire line valve behind a wall and indicates the open or shut position of the valve.

TECHNICAL DATA

Model	PIP
Adjustable Dimension	The wall flange of the PIP is tapped for 4” schedule 40 steel pipe (furnished by customer) which extends through the wall
Adjustment	The opened “OPEN” and closed “SHUT” positions can be adjusted
Operation	Handwheel
Uses	Valve installed behind a wall
Coating	Fusion bonded epoxy coating in accordance with ANSI/AWWA C550
Finish	Red RAL 3000


MATERIALS

ITEM	DESCRIPTION	MATERIAL
1	Body	Cast iron EN-GLJ-200
2	Plug	Malleable iron
3	Square nut	Carbon Steel Zinc Plated
4	Hex. Head Bolt	Carbon Steel Zinc Plated
5	Cover	Cast iron EN-GLJ-200
6	Hand wheel	EN-GJS-450-10
7	Eye bolt	Carbon Steel Zinc Plated
8	Gasket	Carbon Steel Zinc Plated
9	Snap Ring	Spring Steel
10	Operating nut	SS304

C/Alfoz de Bricia nº4 | P.I. Villalonquéjar | 09001 Burgos (Spain) | Tlfno: +34 947 28 11 08

11	Gasket	EPDM
12	Window Glass	Plexiglass
13	Target	Cast Aluminum
14	Hex. Head Bolt	Carbon Steel Zinc Plated
15	Hex. Head Bolt	Carbon Steel Zinc Plated
16	Hexagon nut	Carbon Steel Zinc Plated
17	Target Carrier Nut	SS304
18	Hexagon nut	Carbon Steel Zinc Plated
19	Hex. Head Bolt	Carbon Steel Zinc Plated
20	Stem 1" Square	Carbon Steel
21	Cotter pin	SS304
22	Socket	ASTM A536, 65-45-12

DIMENSIONS (mm)

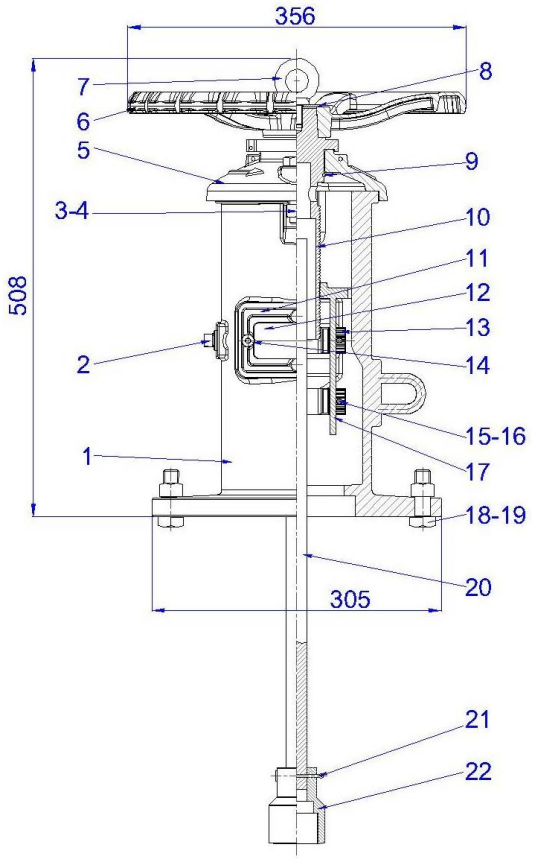

ORDERING INFORMATION

MODEL	CODE
Horizontal indicator post	VPIHFMUL

Specify:

Model	
Quantity	
Size	

The equipment presented in this bulletin is to be installed in accordance with the latest published Standard of the National Fire Protection Association, Factory Mutual Research Corporation, or other similar organizations and also with the provisions of governmental codes or ordinances whenever applicable.
This documentation is not contractual. AG Fire Sprinkler reserves the right to any kind of change without notice.

C/Alfoz de Bricia nº4 | P.I. Villalonquéjar | 09001 Burgos (Spain) | Tlfno: +34 947 28 11 08